

LEVELTEC TILT SWITCH RANGE

RELIABLE . ECONOMICAL . ROBUST



Leveltec Engineering -
Australian & New Zealand

LP01
LP02
LP03



Premium Australian
Quality

- MERCURY Free solutions
- Hazardous area applications
- Simple Device and Installation




LP04
LP041
LP05

SNAP ACTION TILT SWITCHES

- NON Mercury
- Fixed 2 second Hydraulic TIME DELAY
- 3 Wire changeover
- Optional Accessories
 - Float ball
 - Gold contact
 - Hazardous area application
 - BSH Barrier Box
 - BSH Termination Junction Box

MERCURY TILT SWITCH

- Instantaneous Trip
- 2 wire device N/C
- Robust design
- Simple Installation
- Optional Accessories
 - Float ball
 - BSH Termination Junction Box

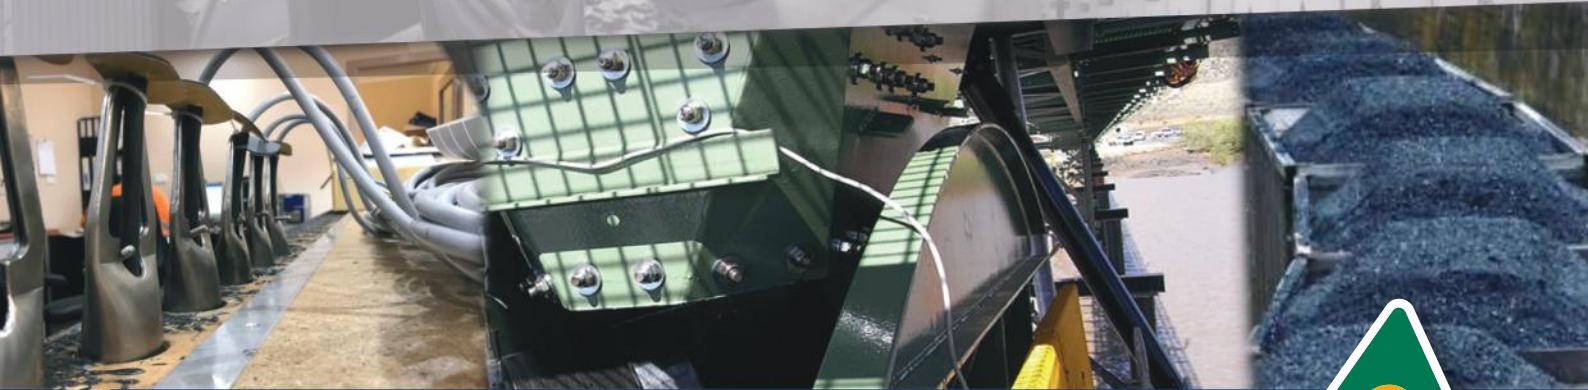

MM004LTC011010618

Leveltec Engineering Pty Ltd

41 Tate Street

GLOUCESTER NSW 2422

Ph: +61 2 6558 9264 Fax: +61 2 6558 1002

Email: sales@leveltec.com.au www.leveltec.com.au

SYDNEY Office Ph: +61 2 9299 5630

NZ Wellington Office Ph: +64 4 896 6285

NZ Wellington Fax: +64 4 896 6271




LEVELTEC


LEVELTEC TILT SWITCH RANGE

RELIABLE . ECONOMICAL . ROBUST

Leveltec Engineering manufactures premium quality tilt switches supplying the solid materials handling industry with outstanding results. Leveltec ensures exceptional quality and superior technical support for every customer to meet their material handling needs.


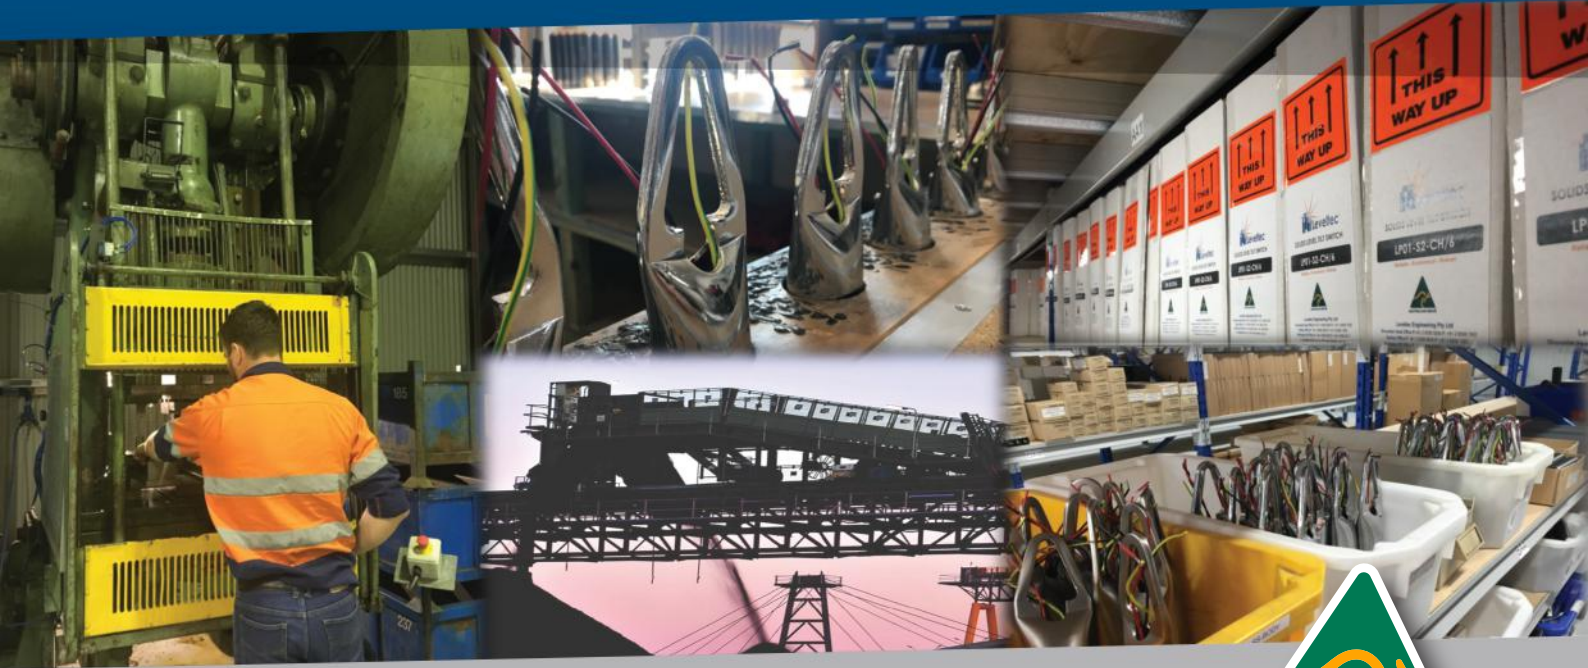


LEVEL MONITORING APPLICATIONS

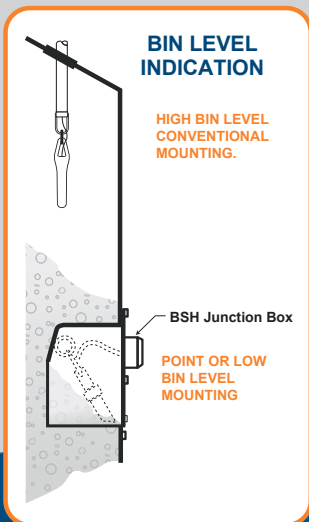

- High bin level indication and control
- Plugged conveyor transfer point detection
- Plugged chute detection
- Crusher bowl level indication and/or control

- Conveyor loss of feed indication or control
- Conveyor belt drift indication and/or alarm
- Boom Stackers
- Radial Stackers

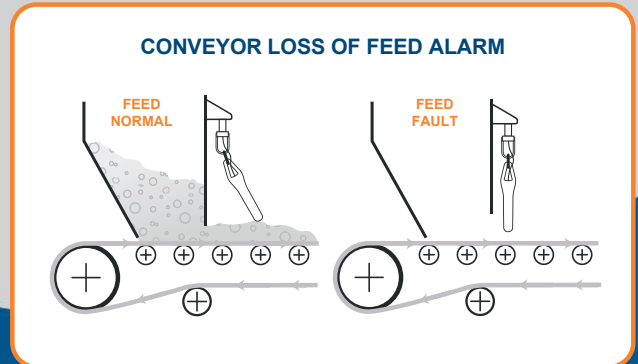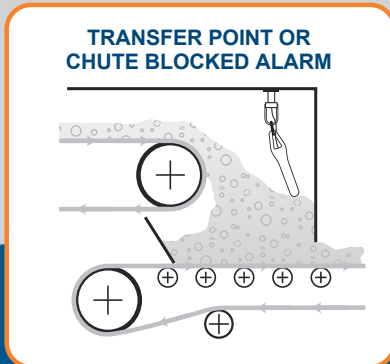

MM004_LTC011010618

Leveltec Engineering Pty Ltd

41 Tate Street

GLOUCESTER NSW 2422

Ph: +61 2 6558 9264 Fax: +61 2 6558 1002

Email: sales@leveltec.com.au www.leveltec.com.au

SYDNEY Office Ph: +61 2 9299 5630

NZ Wellington Office Ph: +64 4 896 6285

NZ Wellington Fax: +64 4 896 6271

* All information and images provided are subject to change